


MODEL	RATING	ELEMENT SPLIT	
DFC2000TI	2000W 230-240V	1100W	900W
DFC1500TI	1500W 230-240V	800W	700W

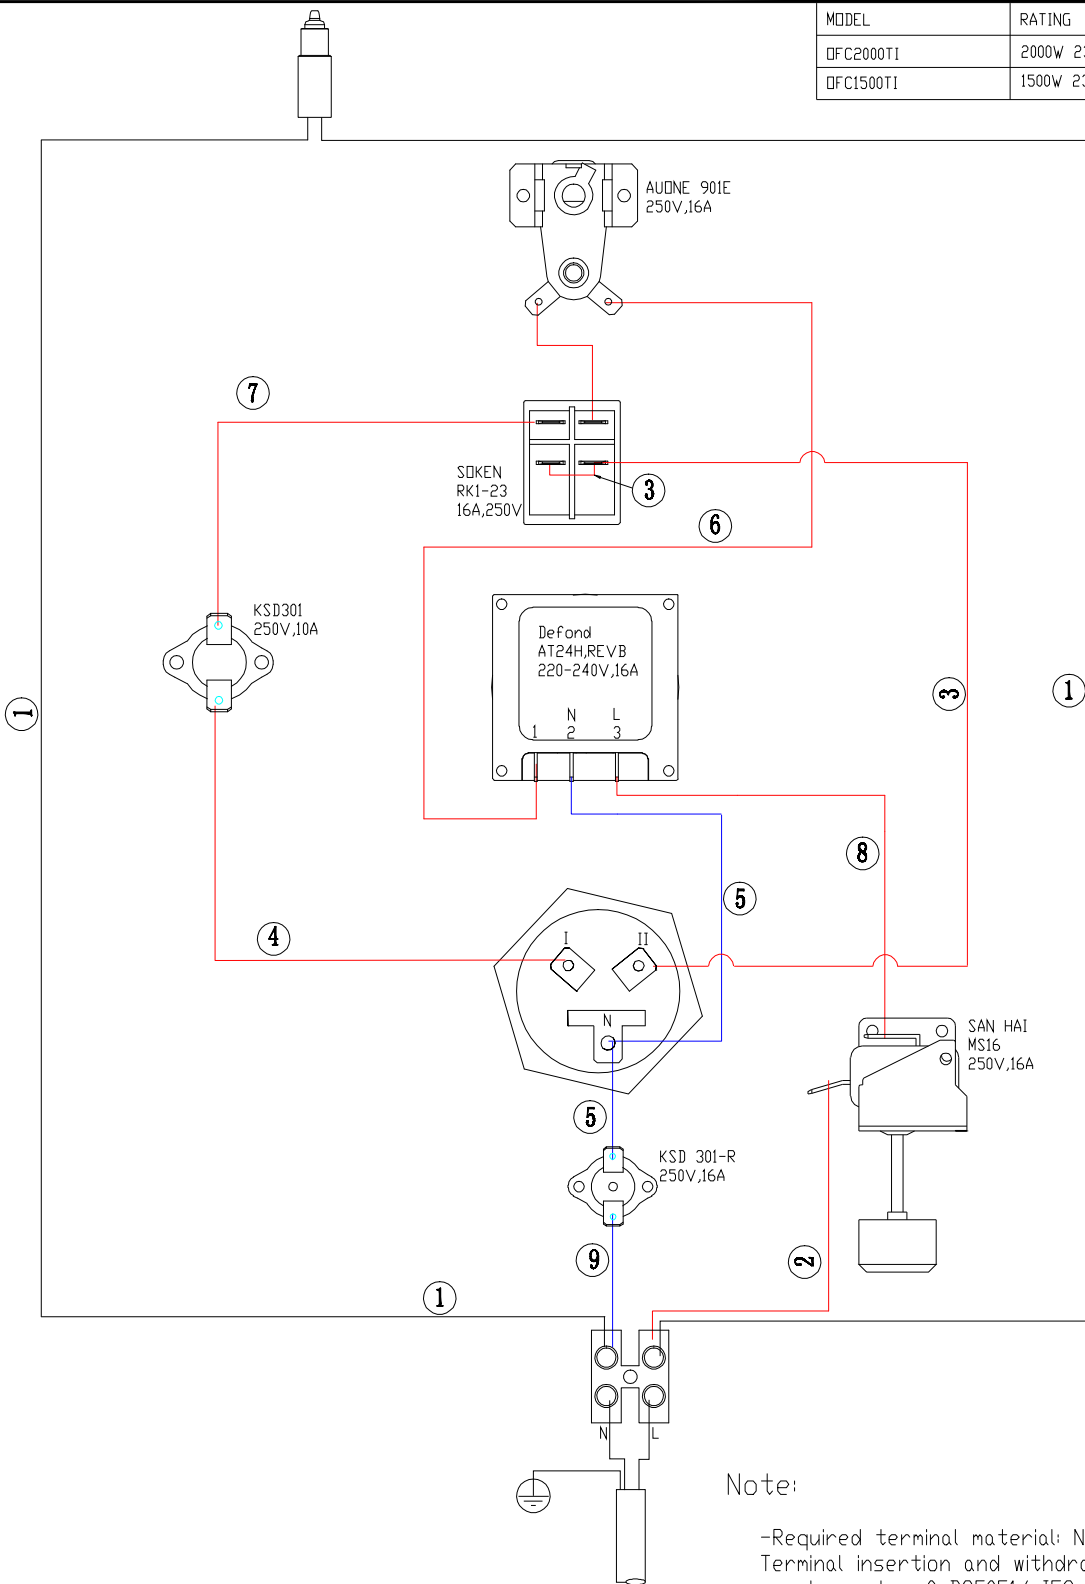

Note:

- Required terminal material: Nickel Plated Steel Terminal insertion and withdrawal force to meet requirements of BS5051/ IEC 760
- Wire lengths & terminal orientation/type to be confirmed by Cuori

ISSUE	MODIFICATIONS	APPD	DATE	NOTES	GLEN DIMPLEX RESEARCH & DEVELOPMENT				THIS DRAWING IS SUPPLIED IN CONFIDENCE AND THE COPYRIGHT THEREOF IS THE PROPERTY OF GLEN DIMPLEX. IT MUST NOT BE USED BY A THIRD PARTY WITHOUT PRIOR PERMISSION. ©2006		
A	RELEASE FOR SAMPLING	RW	12/05/08	All wires to be 1.0mm ² Neon function: Mains On Tolerance on all wire lengths +/-5mm	Dunleer, Co.Louth, Ireland. Tel: 041 9800204. Fax: 041 6851464.				PROJECT <i>Dil Column-DFC 2000TI</i>		
					DRAWN BY RW	DATE 12/05/08	SCALE	HOLE TOL +/-0.05	GEN TOL 0 +/-0.4 0.0 +/-0.2 0.00+/-0.1	TITLE WIRING DIAGRAM	
					APP'D BY	DATE	DIM IN mm	ANGLES +/-0.5°		NO. DFF:	
				DO NOT SCALE IF IN DOUBT ASK	THIRD ANGLE PROJECTION		R.O.H.S. All material must comply with the requirements of European Directive 2002/95/EC on the restriction of the use of certain hazardous substances.			DRG NO 0/11493/0	A4 Sht 1 of 1