


MODEL	RATING	ELEMENT SPLIT	
		II	I
DFC1500	1500W 230-240V	800W	700W
DFC2000	2000W 230-240V	1100W	900W
DFC2500	2500W 230-240V	1250W	1250W

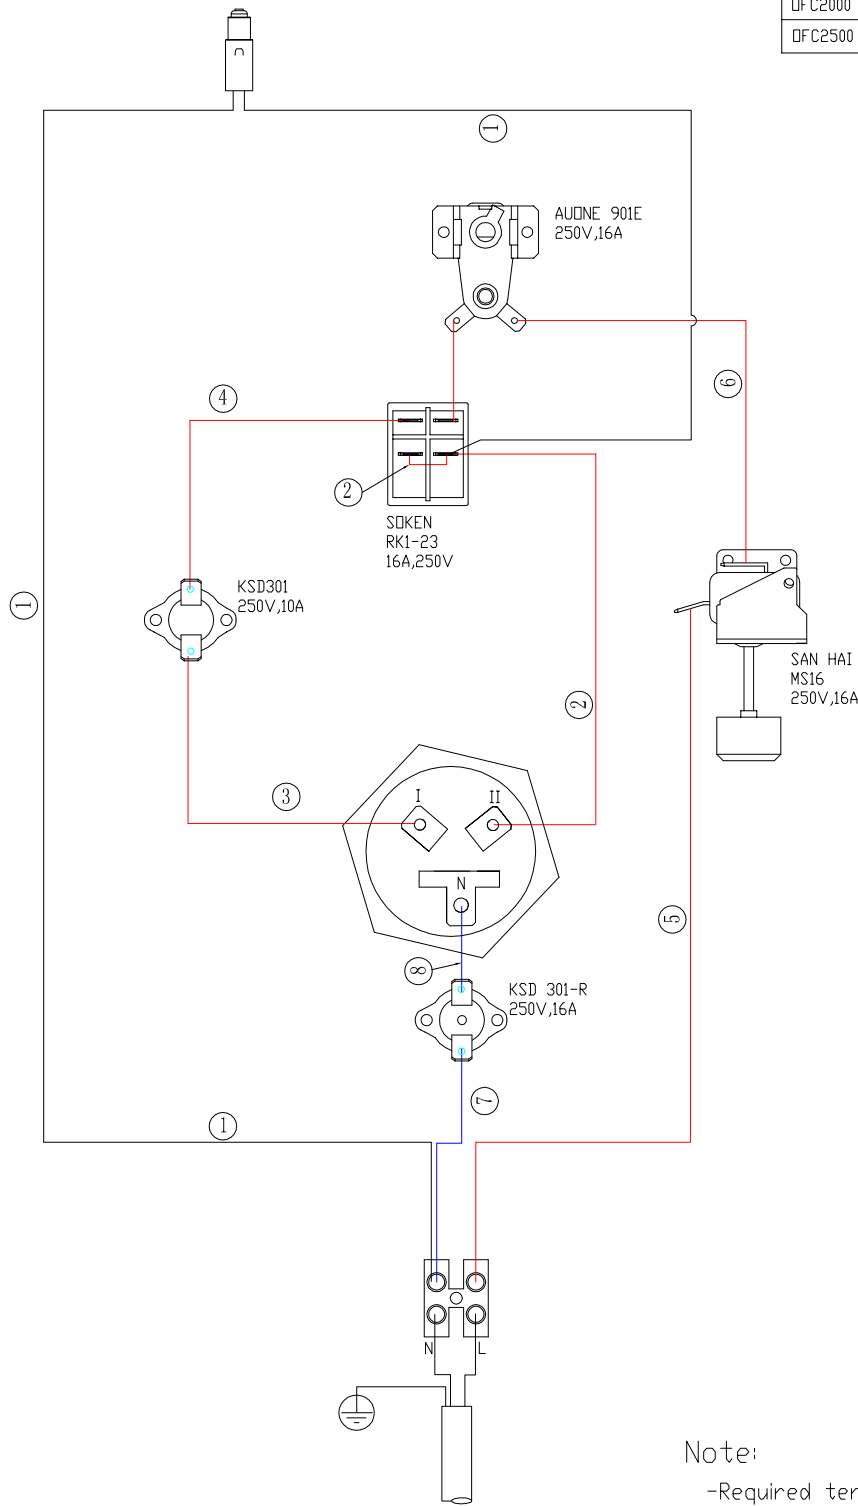

Note:

- Required terminal material: Nickel Plated Steel Terminal insertion and withdrawal force to meet requirements of BS5051/ IEC 760
- Wire lengths & terminal orientation/type to be confirmed by Cuori

ISSUE	MODIFICATIONS	APP'D	DATE	NOTES	GLEN DIMPLEX RESEARCH & DEVELOPMENT				THIS DRAWING IS SUPPLIED IN CONFIDENCE AND THE COPYRIGHT THEREOF IS THE PROPERTY OF GLEN DIMPLEX. IT MUST NOT BE USED BY A THIRD PARTY WITHOUT PRIOR PERMISSION. ©2006	
A	RELEASE FOR SAMPLING	RW	29/08/08	All wires to be 10mm <sup>2</sup> Neon function: operating  Tolerance on all wire lengths +/-5mm	Dunleer, Co.Louth, Ireland. Tel: 041 9800204. Fax: 041 6851464.				PROJECT <i>DII Column-Benelux</i>	
					DRAWN BY <i>RW</i>	DATE <i>29/08/08</i>	SCALE	HOLE TOL +/-0.05	GEN TOL 0 +/-0.4	TITLE <b>WIRING DIAGRAM</b>
					APP'D BY <i>RW</i>	DATE	DIM IN mm	ANGLES +/-0.5'	0,0 +/-0.2 0,00+/-0,1	NO. OFF.
				DO NOT SCALE IF IN DOUBT ASK	R.o.H.S. All material must comply with the requirements of European Directive 2002/95/EC on the restriction of the use of certain hazardous substances.				DRG NO <b>0/11566/0</b>	A4 Sht 1 of 1